

manufacturer test report


testing according to DIN EN 50164-1 (VDE 0185 part 201)

Anschlussklemme Part No. 370 014

material: TG/tZn



DEHN + SÖHNE

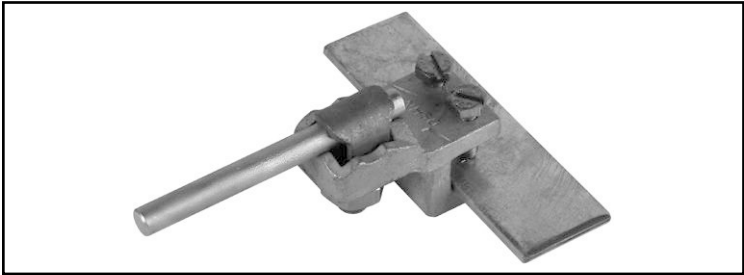

non-binding figure

application: overground

| conductor connected | test result |
|---|-------------|
| 1st conductor : Rd 8 St/tZn 2nd conductor : FI 40x1 St/tZn | N |
| 1st conductor : Rd 8 Al 2nd conductor : FI 40x1 Al | N |
| 1st conductor : Rd 8 NIRO 2nd conductor : FI 40x1 NIRO | N |
| 1st conductor : Rd 8 Al 2nd conductor : FI 30x2 Al | H |

caption

withstand lightning current class H 100 kA (10/350 µs)
withstand lightning current class N 50 kA (10/350 µs)
Detailed data of testing conditions can be requested on demand.