


manufacturer test report
testing according to DIN EN 50164-1 (VDE 0185 part 201)

Anschlussklemme Part No. 371 007
material: RG

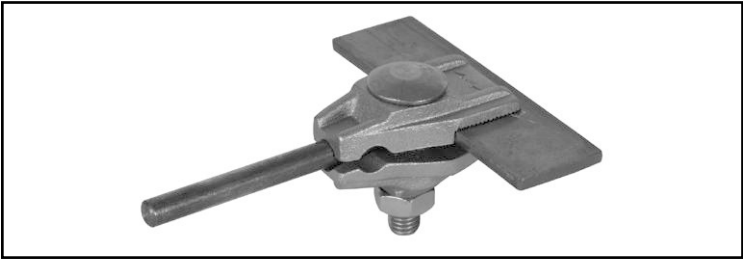

non-binding figure

application: overground

conductor connected	test result
1st conductor : Rd 8 Cu 2nd conductor : FI 30x1 Cu	H
1st conductor : Rd 8 NIRO 2nd conductor : FI 30x1 NIRO	H

caption

withstand lightning current class H 100 kA (10/350 µs)
withstand lightning current class N 50 kA (10/350 µs)
Detailed data of testing conditions can be requested on demand.